


# Advantex™ Treatment System


## AX 20 Series - Mode 3b



Orengo Systems®  
Incorporated

### Water Tight Tankage Spec.

It Is Necessary That Tanks Be Vacuum Or Water Tested To Certify Water Tight Tankage. PVC Acces Risers Must Be Water Tight, Epoxied To Tankage And Bolted Down For Liability Consideration. Contractor/Tank Manufacturer Shall Be Responsible For Repair Or Replacement Of Tanks With Leaks or Defects.

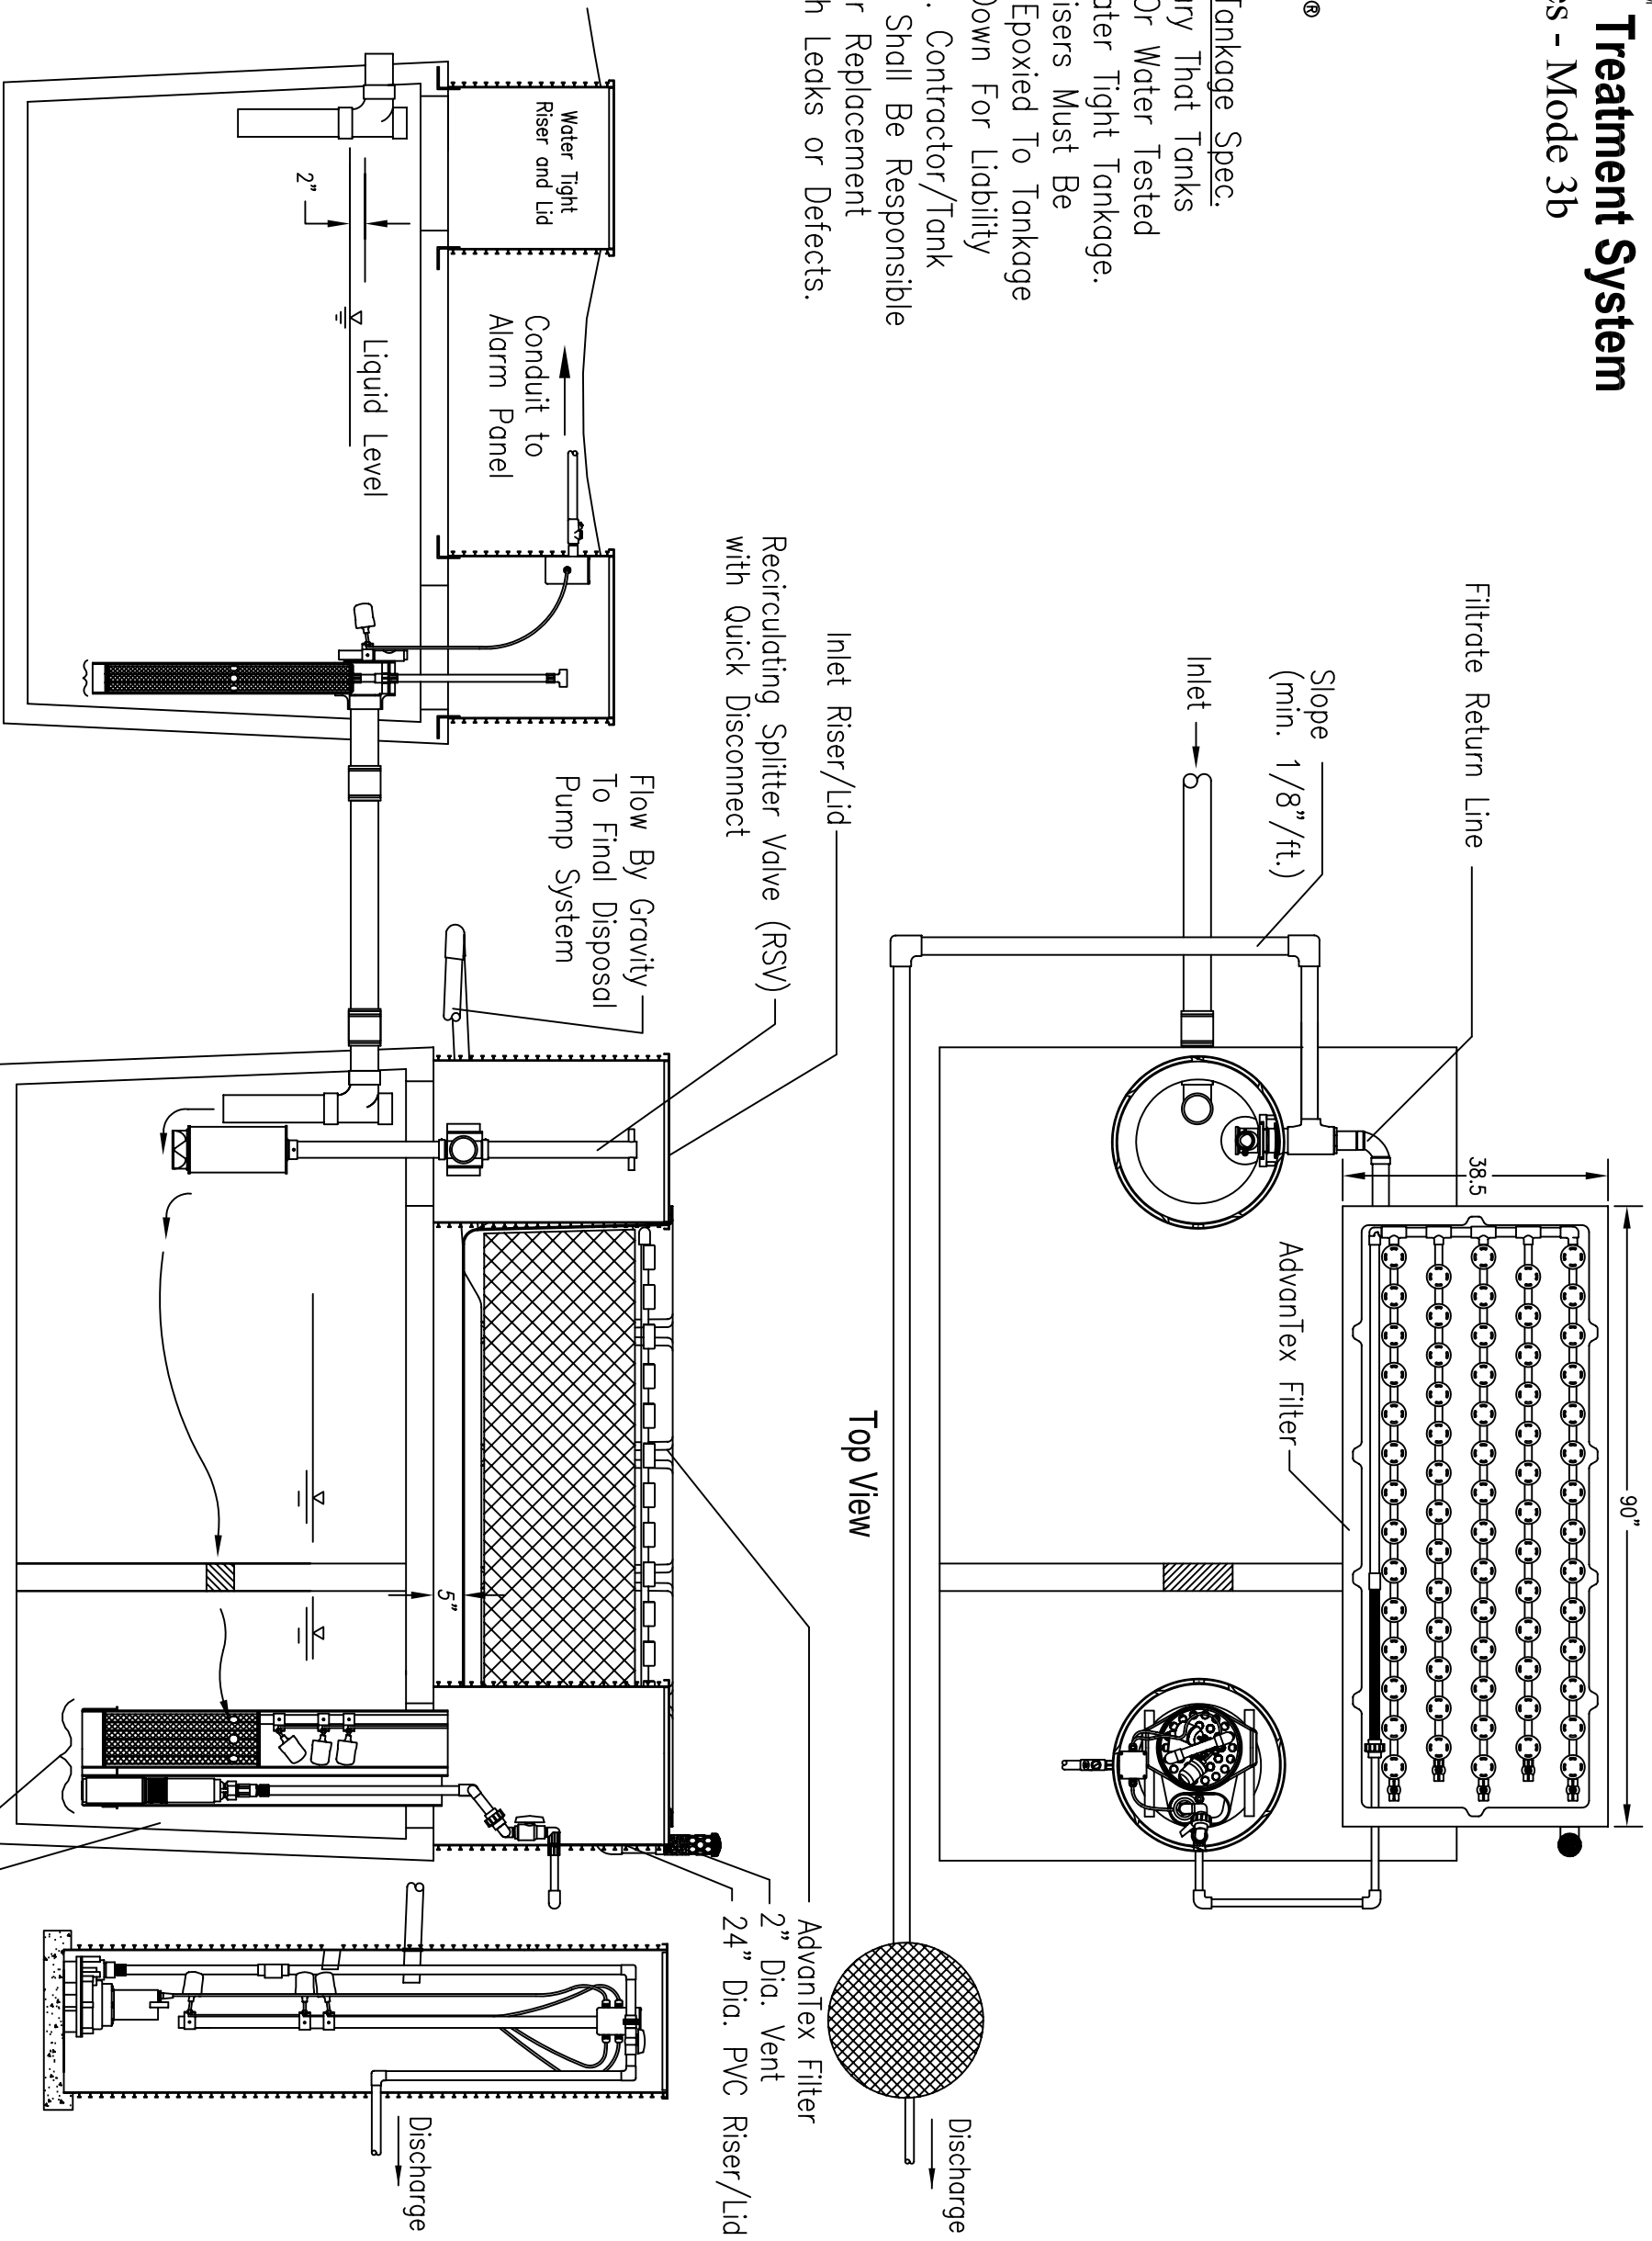

Side View

Top View


2 Compartment Tank  
Biotube® Pump Package

AX 20 Mode 3b (2 Tanks)

Patents # 4,439,323 & 5,492,635  
Foreign Patents Pending  
©Orengo Systems, Inc.

DRAWN	ADL
SCALE	
DATE	12/14/02
APPROVED	

7125 East Pickard Road  
P. O. Box 309  
Mt. Pleasant, MI 48804-0309  
ph-989-773-9938  
fax-989-772-3415

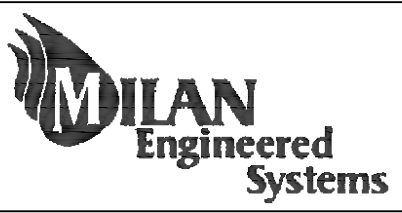

NO	REVISION	DATE	BY
1			
2			
3			
4			
5			

SHEET \_\_\_\_\_ OF \_\_\_\_\_  
DRAWING NO. A20