



Water Tight Tankage Spec.

It Is Necessary That Tanks Be Vacuum Or Water Tested To Certify Water Tight Tankage. PVC Acces Risers Must Be Water Tight, Epoxied To Tankage And Lids Bolted Down For Liability Consideration. Contractor/Tank Manufacturer Shall Be Responsible For Repair Or Replacement Of Tanks With Leaks Or Defects. Tankage Must Have 3 Year Warranty

Patents # 4,439,323 & 5,492,635
Foreign Patents Pending
© Orenco Systems, Inc.

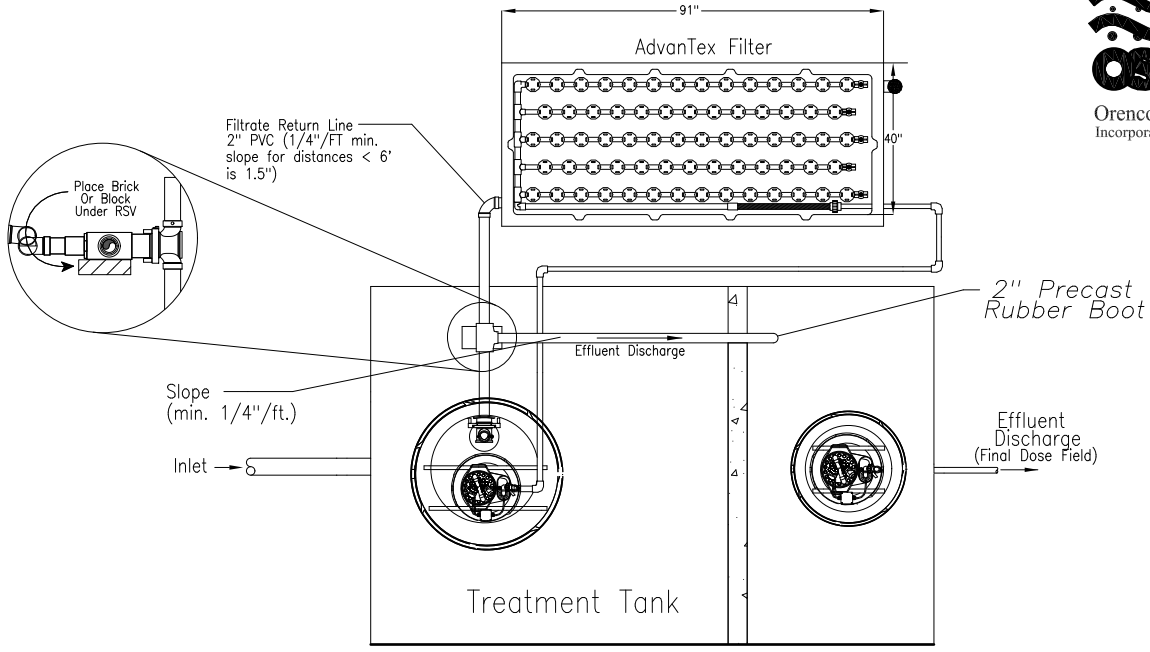

Note: AdvanTex Piping Must Not Settle

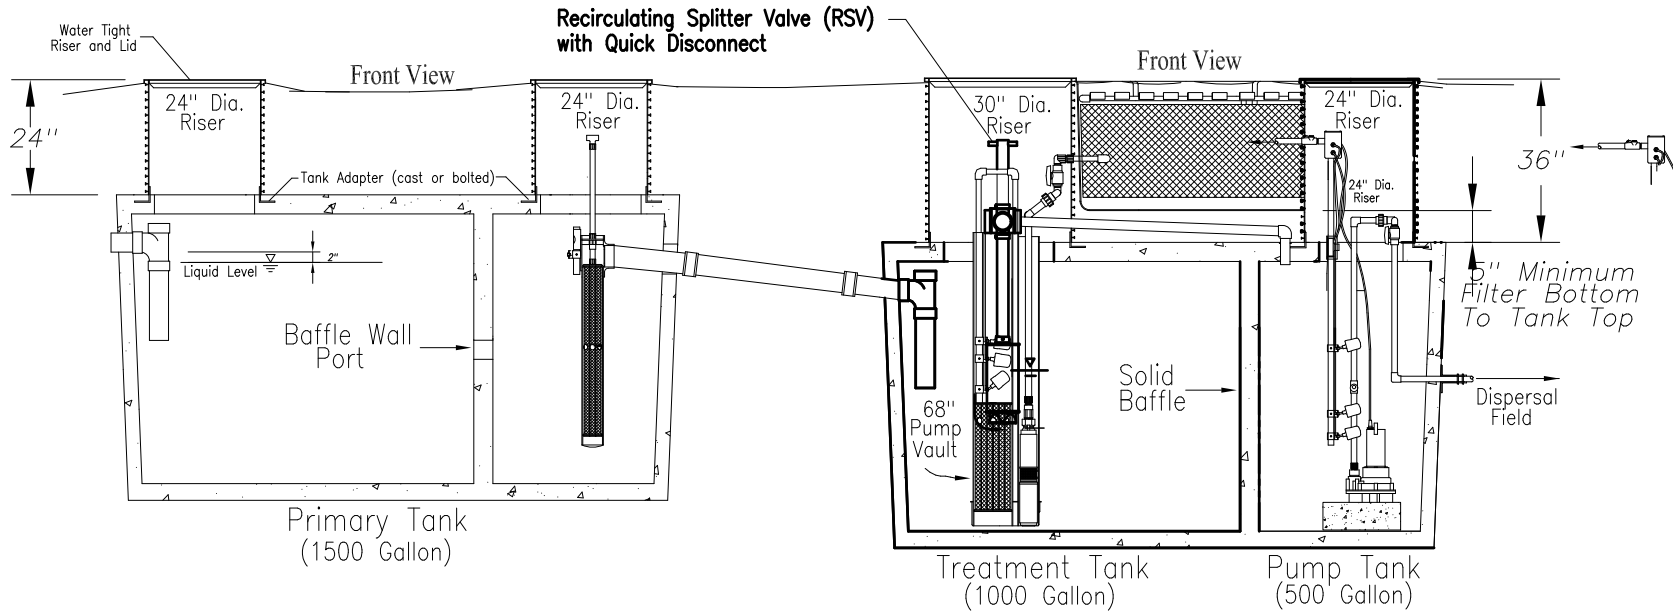

AdvanTex™ Treatment System
AX 20 Series - Mode 3b

AX 20 b 1500 1500 LH

DRAWN	jdu
SCALE	
DATE	12/20/04
APPROVED	

7125 East Pickard Road
P. O. Box 309
Mt. Pleasant, MI 48804-0309
ph-989-773-9938
fax-989-772-3415



BY	jdu				
DATE	12/04				
REVISION	6/08				

NO	1.	2.	3.	4.	5.
SHEET					
				1	
				OF	

DRAWING NO. AX-P-LH+