


Splice Box Wiring Detail

(3 Float System: Float Activated pump with an alarm panel)

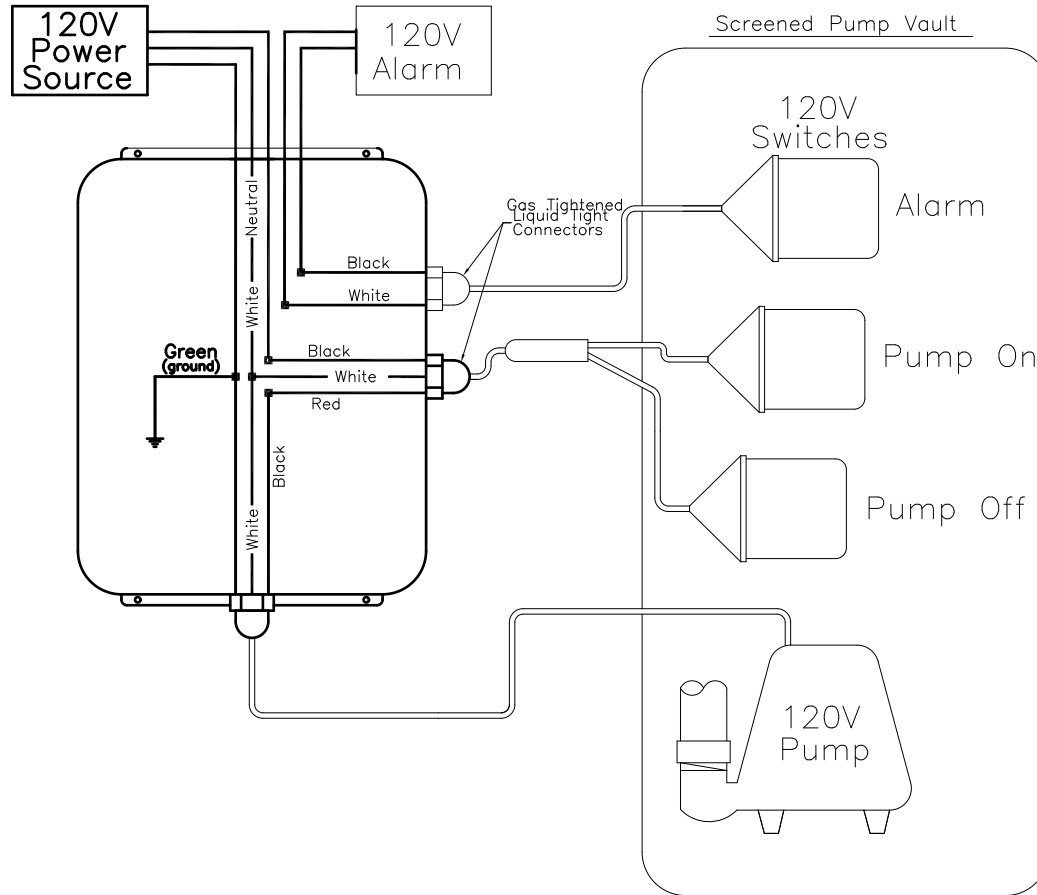

Notes:

- Floats Are Not Preset For Pumping Levels
- Conduit Seal-Off Outside Of Riser
- Heat Shrink Connectors, Or Silicone Filled Wire Nuts Should Be Used
- Switches Are N.O. signal Floats

DRAWING NO. FL3	SHEET OF 1	NO	REVISION	DATE	BY	 <p>7125 East Pickard Road P. O. Box 309 Mt. Pleasant, MI 48804-0309 ph-989-773-9938 fax-989-772-3415</p>	DRAWN jdu
		1.	12/04		jdu		SCALE
		2.					DATE 12/20/04
		3.					APPROVED
		4.					
5.							