




Orengo Systems[®]
Incorporated

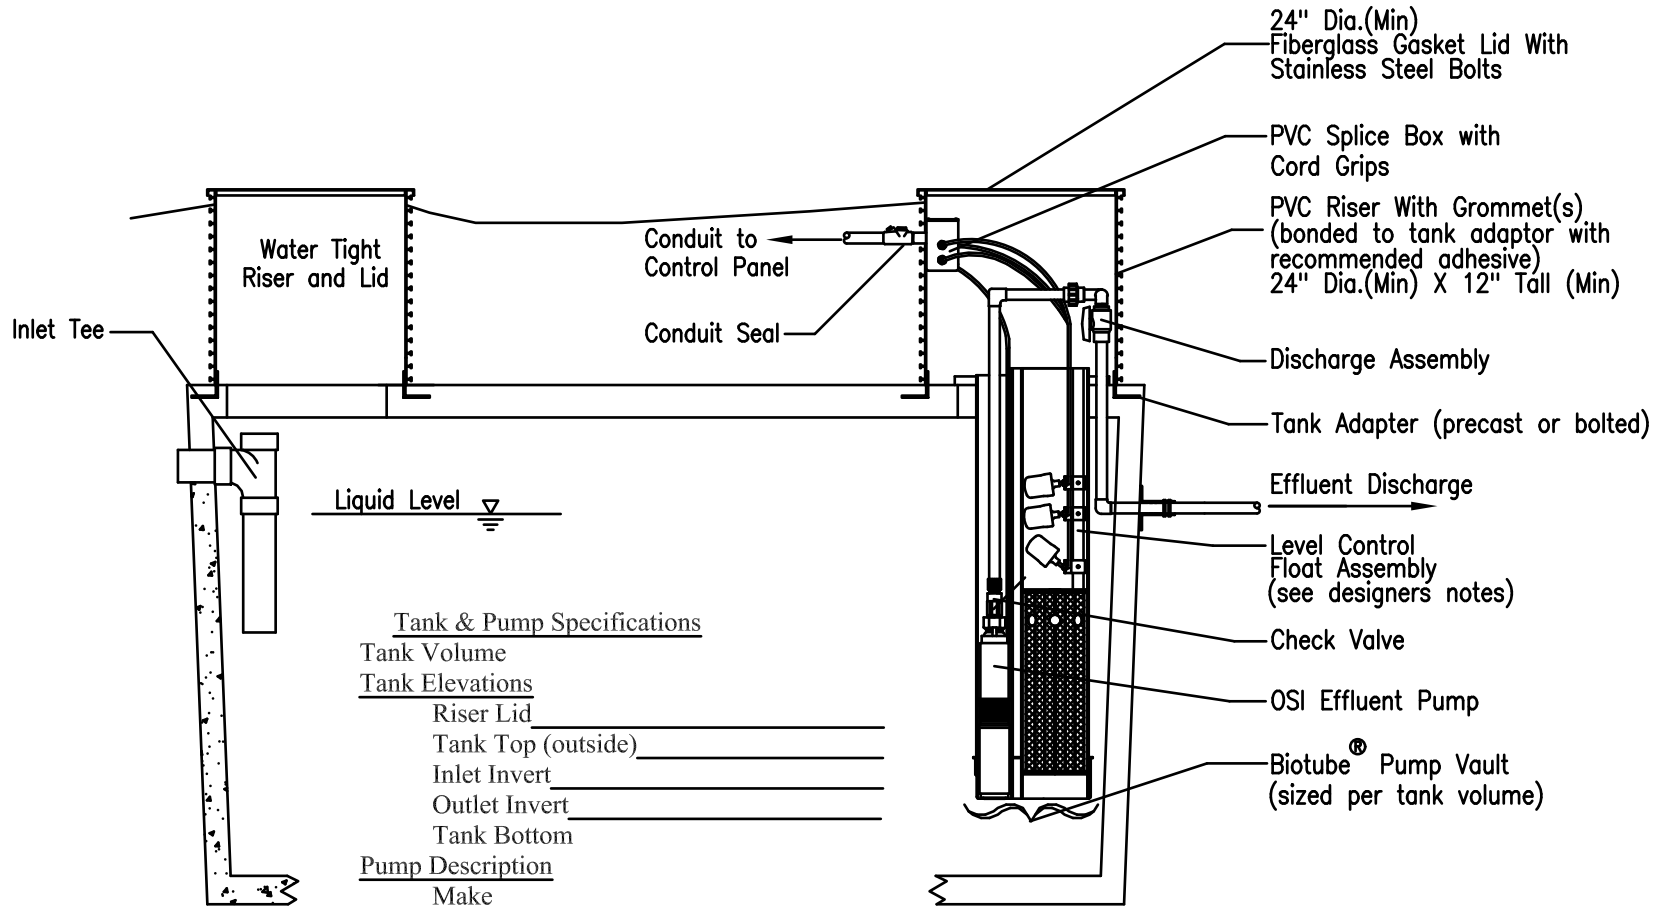

Tank & Pump Specifications

- Tank Volume _____
- Tank Elevations
- Riser Lid _____
- Tank Top (outside) _____
- Inlet Invert _____
- Outlet Invert _____
- Tank Bottom _____
- Pump Description
- Make _____
- Model _____
- GPM @ TDH _____
- HP _____
- Voltage/Phase _____
- Dose Volume _____
- Pump Vault Model _____
- Dischrge Assembly Model _____
- Float Model _____
- Control Panel Model _____

Water Tight Tankage Spec.
It Is Necessary That Tanks Be Vacuum Or Water Tested To Certify Water Tight Tankage. PVC Acces Risers Must Be Water Tight, Epoxied To Tankage And Lids Bolted Down For Liability Consideration. Contractor/Tank Manufacturer Shall Be Responsible For Repair Or Replacement Of Tanks With Leaks or Defects. Tankage Must Have 3 Year Warranty.

Patents # 4,439,323 & 5,492,635
Foreign Patents Pending
© Orengo Systems, Inc.

STEP System
Septic Tank Effluent Pump
Model: STEP HH PV(Single
Compartment Tank)

DRAWN jdu
SCALE
DATE 12/20/04
APPROVED

7125 East Pickard Road
P. O. Box 309
Mt. Pleasant, MI 48804-0309
ph-989-773-9938
fax-989-772-3415



REVISION	DATE	BY	APP
1	12/04	JDU	
2	12/21/2007		
3			
4			
5			

DRAWING NO. S1