




Orenco Systems[®]
Incorporated

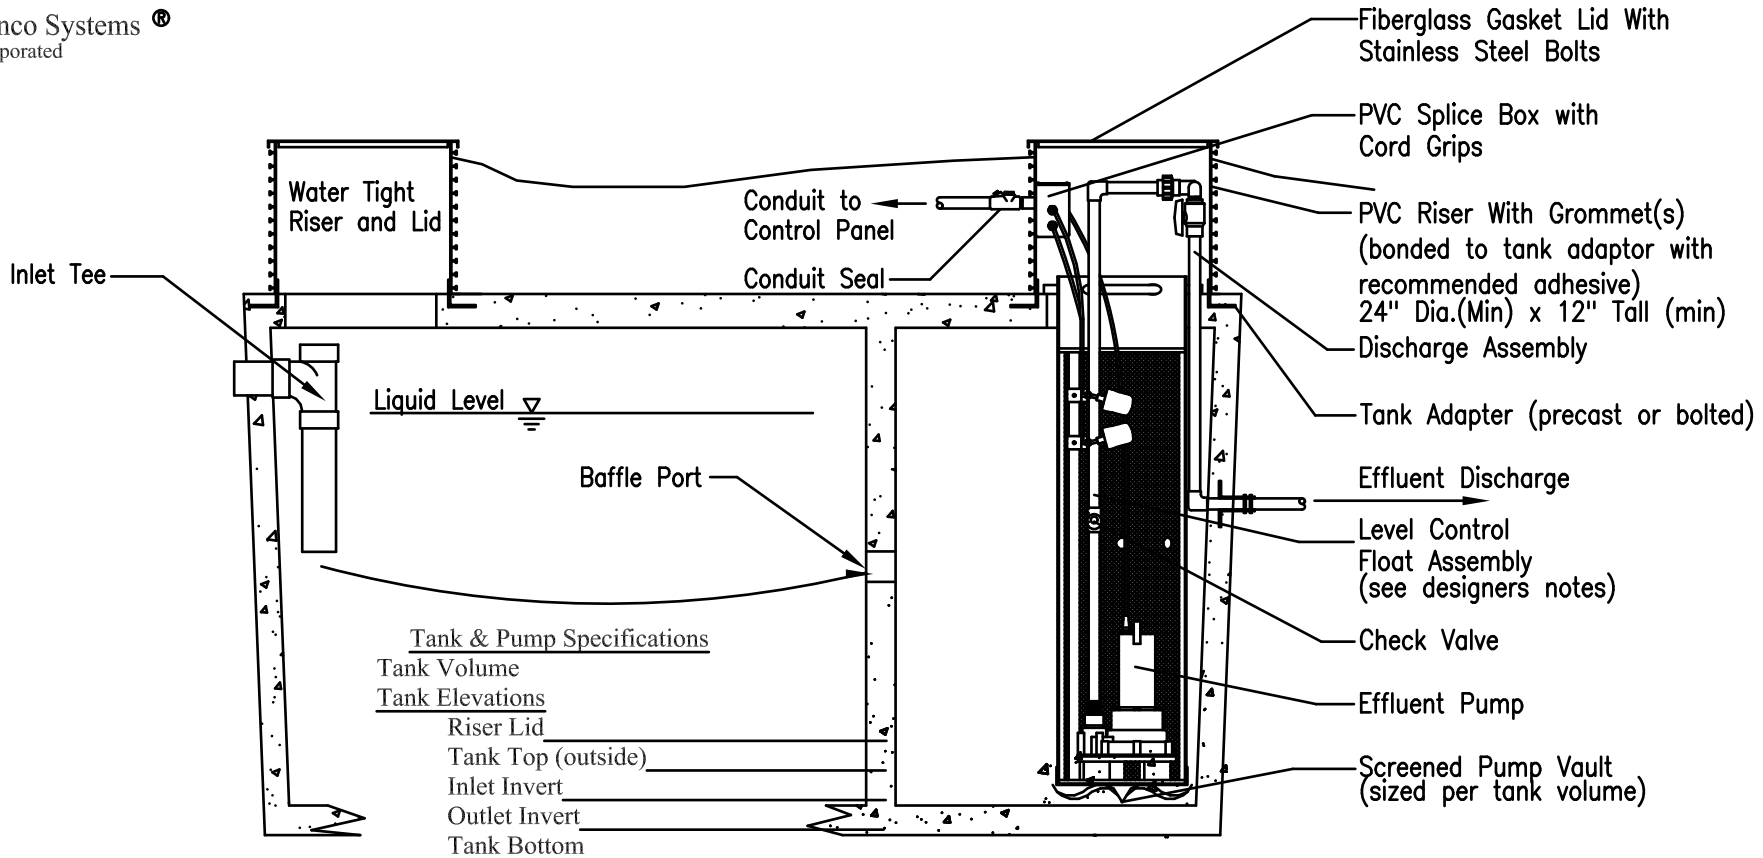

Tank & Pump Specifications

Tank Volume _____
Tank Elevations _____

Riser Lid _____
Tank Top (outside) _____
Inlet Invert _____
Outlet Invert _____
Tank Bottom _____

Pump Description

Make _____
Model _____
GPM @ TDH _____
HP _____
Voltage/Phase _____
Dose Volume _____
Pump Vault Model _____
Dischrg Assembly Model _____
Float Model _____
Control Panel Model _____

Water Tight Tankage Spec.

It Is Necessary That Tanks Be Vacuum Or Water Tested To Certify Water Tight Tankage. PVC Acces Risers Must Be Water Tight, Epoxied To Tankage And Lids Bolted Down For Liability Consideration. Contractor/Tank Manufacturer Shall Be Responsible For Repair Or Replacement Of Tanks With Leaks or Defects. Tankage Must Have 3 Year Warranty.

STEP System
Septic Tank Effluent Pump
Model: STEP LH PV (2 Comp Tank)

DRAWN jdu
SCALE
DATE 12/20/04
APPROVED

7125 East Pickard Road
P. O. Box 309
Mt. Pleasant, MI 48804-0309
ph-989-773-9938
fax-989-772-3415



NO	REVISION	DATE	BY
1.	12/04		jdu
2.	12/21/2007		
3.			
4.			
5.			

SHEET _____ OF _____

DRAWING NO. S5A